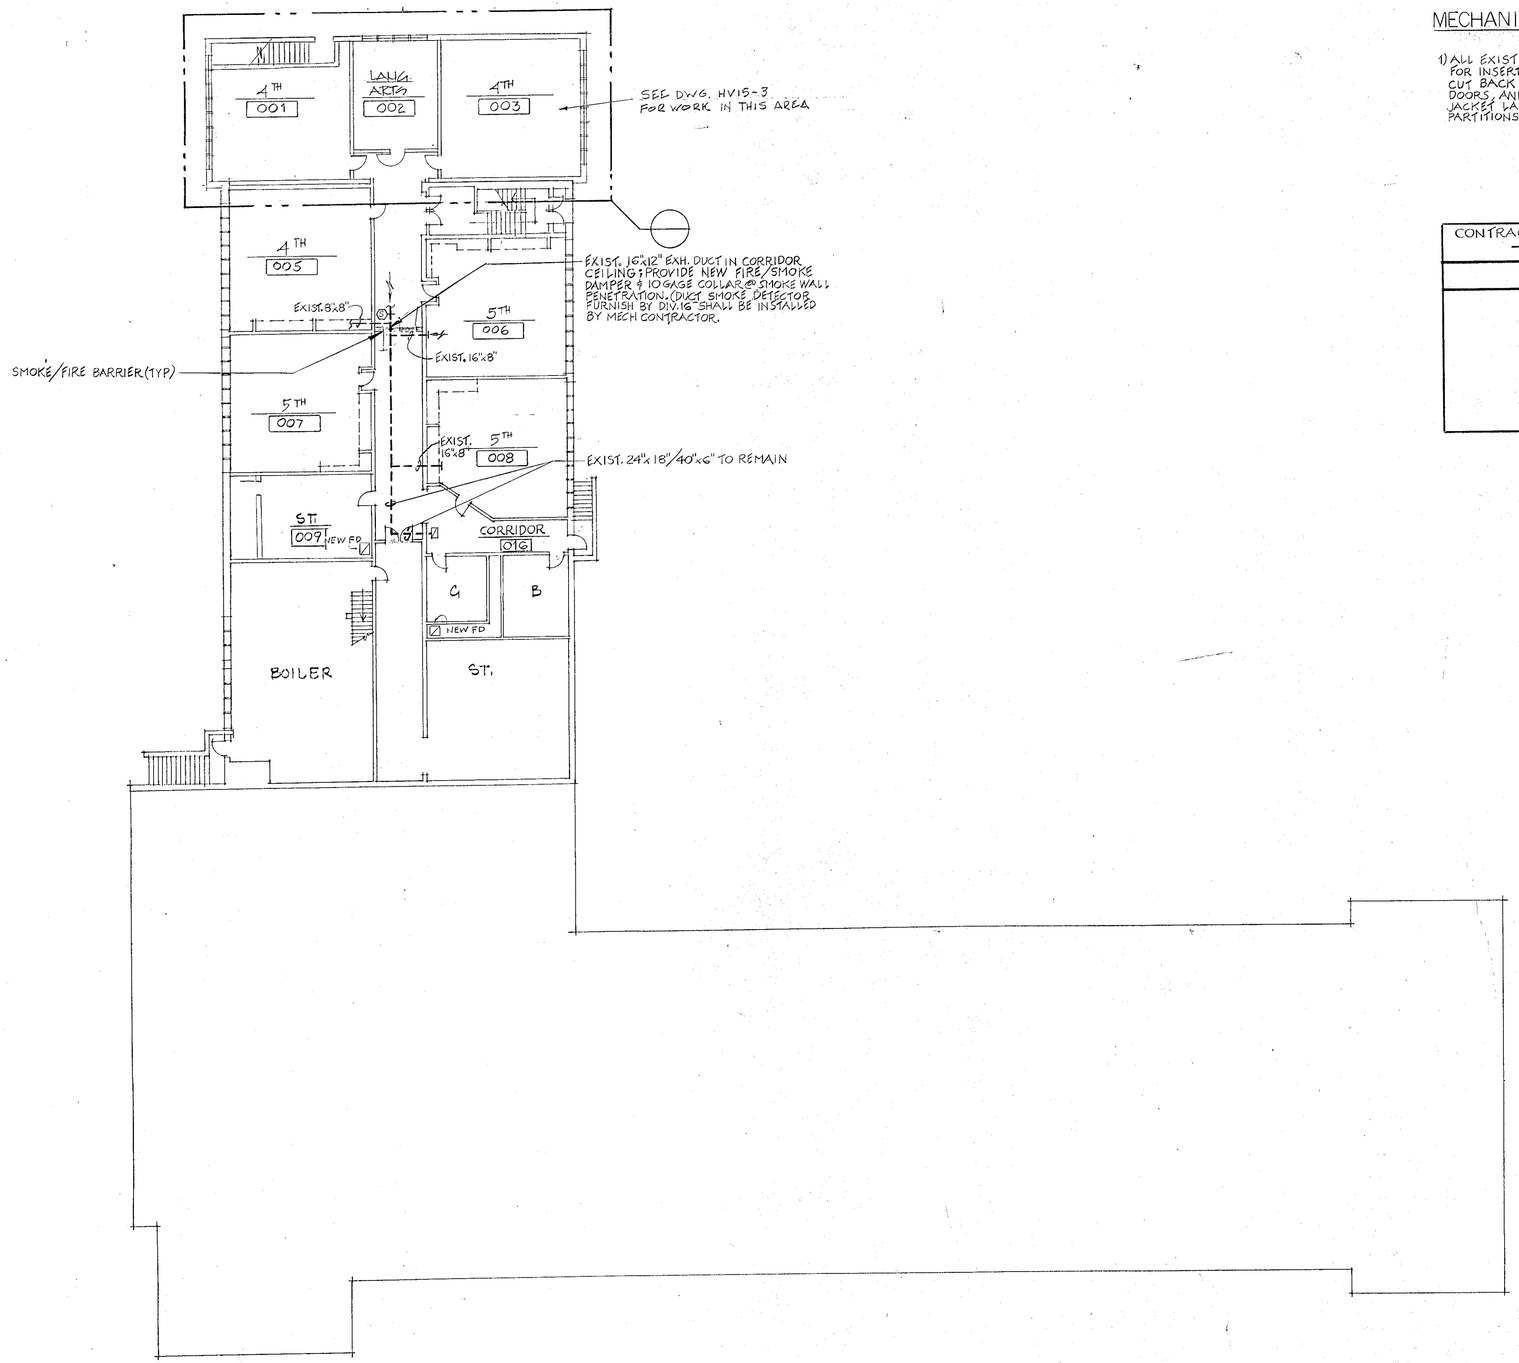

LOWER LEVEL
1/16" = 1'-0"

MECHANICAL NOTES:

1) ALL EXISTING DUCTWORK REQUIRING NEW FIRE DAMPERS SHALL BE CUT TO ALLOW FOR INSERTION OF NEW FIRE DAMPERS & ACCESS DOORS (INSULATION SHALL BE CUT BACK AS REQUIRED TO FACILITATE WORK). INSTALL NEW DAMPERS, ACCESS DOORS, AND SEAL DUCT AIR TIGHT. REINSULATE DUCT AS REQUIRED, INSTALL NEW JACKET LAPPING, AND SEAL INSULATION. SEALING OF PENETRATIONS AT FIRE RATED PARTITIONS AROUND NEW FIRE DAMPERS SHALL BE WORK OF THE GENERAL CONTRACTOR.

CONTRACTOR SHALL INCLUDE COST TO REPLACE ALL STEAM TRAPS
THE FOLLOWING NUMBERS & SIZES APPLY

NUMBER	SIZE
32	3/4"
1	2"
2	1"
1	1 1/2"

FIRE DAMPERS

Contractor shall include the cost of providing 35 fire dampers in ductwork which penetrates corridor walls.

JANSEN & ROGAN
CONSULTING ENGINEERS, P.C.
121 WHITNEY AVENUE
NEW HAVEN, CT. 06510

STATE PROJECT # 034-89-115-EA

Antinozzi Associates
Architects
4021 Main Street
Stratford, Connecticut

DANBURY SCHOOLS REORGANIZATION
CITY OF DANBURY
PARK AVENUE ELEMENTARY
DANBURY, CONNECTICUT

KEY FLOOR PLAN
LOWER LEVEL
HEATING AND VENTILATION

HV15-1

CHECKED BY | SCALE 1/16" = 1'-0" | DATE 7-24-91 | JOB NO.