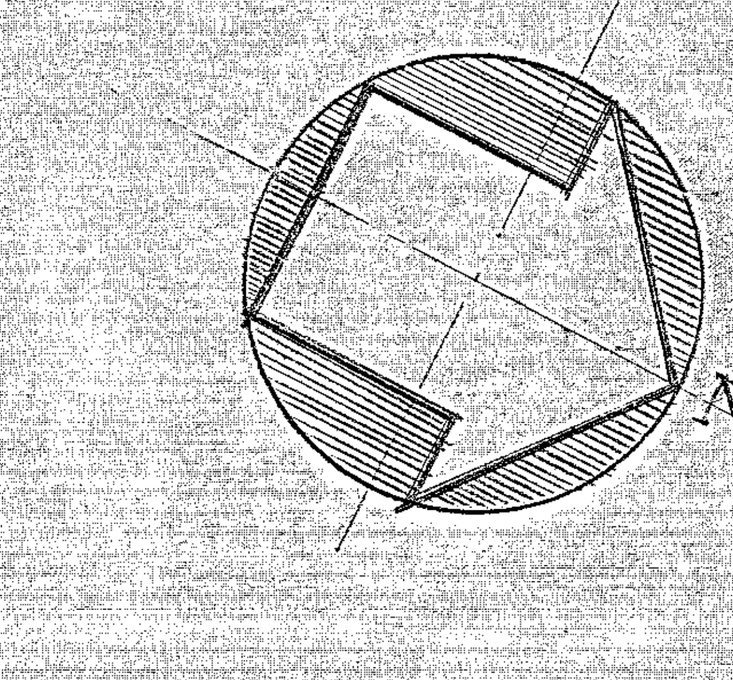

DRAINAGE NOTES

1. ALL CONNECTIONS IN STORM WATER LINES SHALL BE "WYE" TYPE.
2. CONTRACTOR SHALL BACKFILL WITH APPROVED SAND OR GRAVEL OVER TOP OF PIPE TO BOTTOM REQUIRED BASE WHEN STORM LINES CROSS DRIVES AND PARKING.
3. ALL GRATES AND/OR COVERS OF DRAINAGE STRUCTURES SHALL HAVE APPROVED LOCKING DEVICES.
4. LAST SECTION OF 24" RCP AT OUTFALL SHALL BE "FLARED END SECTION". BED LAST 20' OF PIPE ADJ. TO OUTFALL IN 6" MIN. CRUSHED GRAVEL

LEGEND

---548---	EXISTING CONTOUR
	PROPERTY LINE
D.I.	DRAIN INLET
M.H.	MANHOLE
H.W.	HEADWALL
T.F.	TOP OF FRAME
F.L.	FLOW LINE
V.T.	VITRIFIED TILE
CONC.	CONCRETE PIPE
R.C.P.	REINFORCED CONC. PIPE
A.W.	AREA WAY

SEE DRAWING L-3 FOR LIST OF PLANT MATERIALS.

SITE LAYOUT, DRAINAGE & PLANTING

STADLEY ROUGH ELEMENTARY SCHOOL
DANBURY CONN.

FRANK A. LaCAVA
ARCHITECT
DANBURY, CONN.

SCALE: 1" = 40'-0"
REVISION:
DATE: 10-28-69
DWG. NO. L2

STATE OF CONNECTICUT · FRANCIS A. LaCAVA · 349 · REGISTERED ARCHITECT

STATE OF CONNECTICUT · WILLIAM A. MAINE · No. 1 · REGISTERED LANDSCAPE ARCHITECT

4