


SCHEMATIC
INDOOR A.G.R.U.(AUTOMATIC GREASE RECOVERY UNIT)
PLAN
 (NOT TO SCALE)

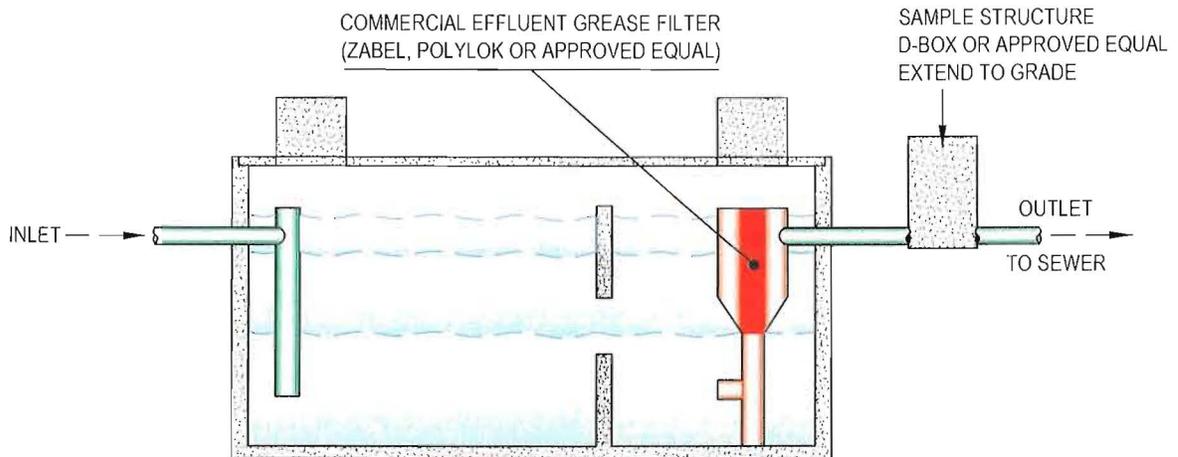

SCHEMATIC
OUTSIDE IN GROUND GREASE TRAP
PROFILE
 (NOT TO SCALE)

GENERAL NOTES:

1. UNITS SHALL BE DESIGNED, SIZED, INSTALLED, OPERATED AND MAINTAINED IN ACCORDANCE WITH CT. D.E.E.P. GENERAL PERMIT.
2. INSTALLATION OF GREASE TRAP UNIT WILL REQUIRE A PLUMBING PERMIT FROM THE CITY OF DANBURY PERMIT CENTER.
3. SIZE A.G.R.U. IN ACCORDANCE WITH MANUFACTURE'S RECOMMENDATIONS TO PROPERLY PRE-TREAT ALL CONNECTED FIXTURES OR DRAINS.
4. OUTSIDE IN GROUND GREASE TRAP SIZE: MIN. 1,000 GAL. OR EQUAL TO MAXIMUM DAILY FLOW.
5. EXISTING GREASE TRAPS TO BE RETROFITTED WITH COMMERCIAL EFFLUENT GREASE FILTERS-INSTALL INSIDE OR OUTSIDE EXISTING TANK.

REVISIONS		
No.	DATE	COMMENTS
1	6/20/12	

CITY OF DANBURY
 PUBLIC UTILITIES
 SEWER DEPARTMENT

GREASE TRAP
 INSTALLATION SCHEMATIC
 FOR FOOD PREPARATION
 ESTABLISHMENT

CHECKED BY: D.D.

DRAWN BY: P.J.T.